



Fisa tehnica

Flair 325

Aparat de recuperare a căldurii
Românesc



Air for Life

General

Modelele Flair 325 și Flair 325 Plus sunt unități de ventilare cu recuperarea căldurii menite pentru ventilarea echilibrată a locuințelor.

Caracteristici:

- Capacitate maximă 325 m³/h
- Schimbător de căldură din plastic cu randament mare
- Filtre ISO Coarse 60%
- Preîncălzitor modular electric
- Supapă de derivație automată
- Ecran tactil
- Cantitate de aer ajustabilă
- Indicarea filtrului pe aparat și posibilitatea indicării filtrului pe comutatorul multiplu
- Protecție inteligentă împotriva înghețului, inclusiv preîncălzitor modular
- Nivel de zgomot redus
- Control constant al fluxului

Modelul Flair 325 este disponibil în două tipuri:

- **"Flair 325"**
- **"Flair 325 Plus"**

Modelul Flair 325 Plus are comparativ cu modelul standard Flair 325, un pcb extra ce îi conferă mai multe funcții/posibilități de conectare (→).

Aceste instrucțiuni de instalare se aplică atât modelului standard Flair 325, cât și modelului Flair 325 Plus.

Modelele Flair 325 și Flair 325 Plus sunt disponibile în versiuni atât **de stânga**, cât și **de dreapta**; nu este posibil să converțiți un model de stânga într-unul de dreapta
Pentru conductele de aer și dimensiunile corecte (→).

Cu toate acestea, este posibil să echipați ulterior aparatul cu un pcb Plus.

Aparatul vine gata de utilizat cu un ștecher de rețea de 230 V.


Informații tehnice

Informații tehnice

Flair 325 (Plus)										
Tensiune de alimentare [V/Hz]	230V/50Hz									
Dimensiuni (lățime x înălțime x adâncime) [mm]	750 x 650 x 560									
Diametru conductă [mm]	ø160									
Diametru descărcător de condens extern [mm]	ø32									
Greutate [kg]	37									
Clasa de filtre	ISO Coarse 60% (ISO ePM1.0 50% opțional pentru alimentarea cu aer)									
Setarea ventilatorului (setări din fabricație)	0	1	2	3	max					
Setări din fabricație [m³/h]	50	100	150	250	325					
Rezistența permisivă a sistemului de conducte [Pa]	2	6	9	24	21	53	59	148	100	250
Puterea nominală (excl. preîncălzitorul) [W]	6,1	6,6	7,9	10,3	15,1	21,0	46,6	69,1	87,5	144,5
Curentul nominal (excl. preîncălzitorul) [A]	0,08	0,08	0,09	0,11	0,15	0,21	0,41	0,59	0,73	1,07
Curentul nominal max. (incl. preîncălzitorul activat) [A]	6									
Cos φ	0,341	0,343	0,389	0,394	0,430	0,439	0,492	0,507	0,521	0,542
Puterea acustică										
Capacitatea de ventilare [m³/h]			100	150	150	200	200	250	325	
Nivel putere acustică Lw(A)	Presiune statică [Pa]		25	25	50	50	100	150	150	
	Radiație prin carcasă [dB(A)]		27	34	35	40	41	46	51	
	Conducta „dinspre locuință” [dB(A)]		32	40	38	46	44	49	55	
	Conducta „înspre locuință” [dB(A)]		44	49	51	55	57	62	69	

*) Zgomot conductă, incluzând ajustare de capăt

În practică, valoarea poate să difere cu 1dB(A) prin toleranțele măsurătorilor.

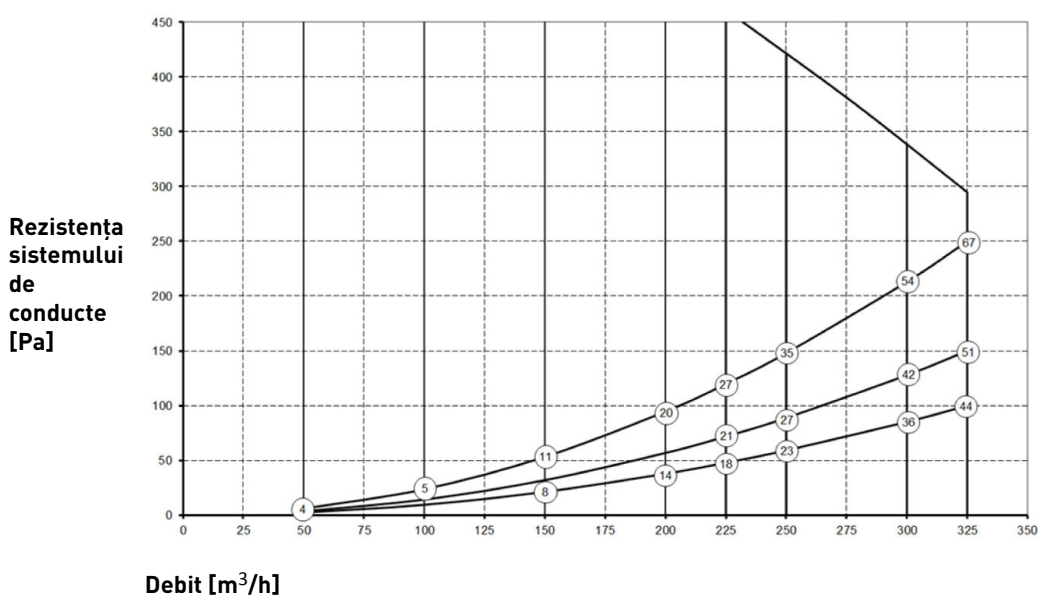


Notă:

Valoarea specificată în acest cerc este capacitatea (în wați) per ventilator.

Racordări și dimensiuni

Aparatul Flair este disponibil în versiunea de stânga și în versiunea de dreapta. La versiunea pentru de stânga, racordurile „calde” (dinspre locuință 3 și înspre locuință 1) se află pe latura stângă a aparatului; descărcătorul de condens este ulterior montat la deschiderea din dreapta, aflată sub aparat. În cazul versiuni de dreapta, racordurile „calde” (1 & 3) se află pe latura dreaptă a aparatului.


Versiunea de stânga

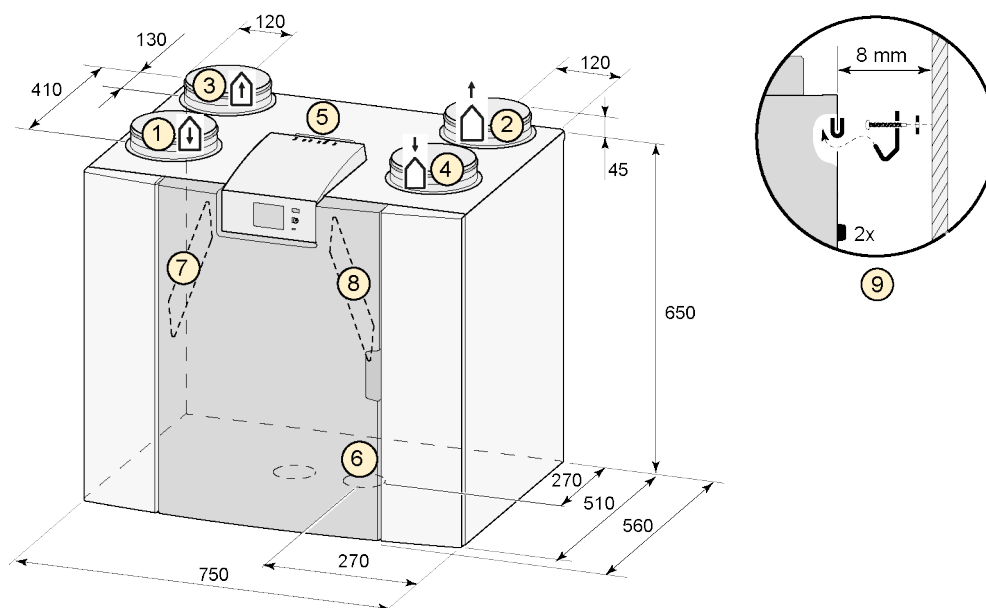

Toate dimensiunile sunt în milimetri. Diametrul tuturor brățărilor este 160 mm

1	Înspre	
2	locuință înspre exterior	
3	Dinspre locuință	
4	Dinspre exterior	
5	Conexiuni electrice	
6	Siphon connection	
7	Filtru aer evacuat	
8	Filtru alimentare aer	
9	Montaj	

Versiunea de dreapta

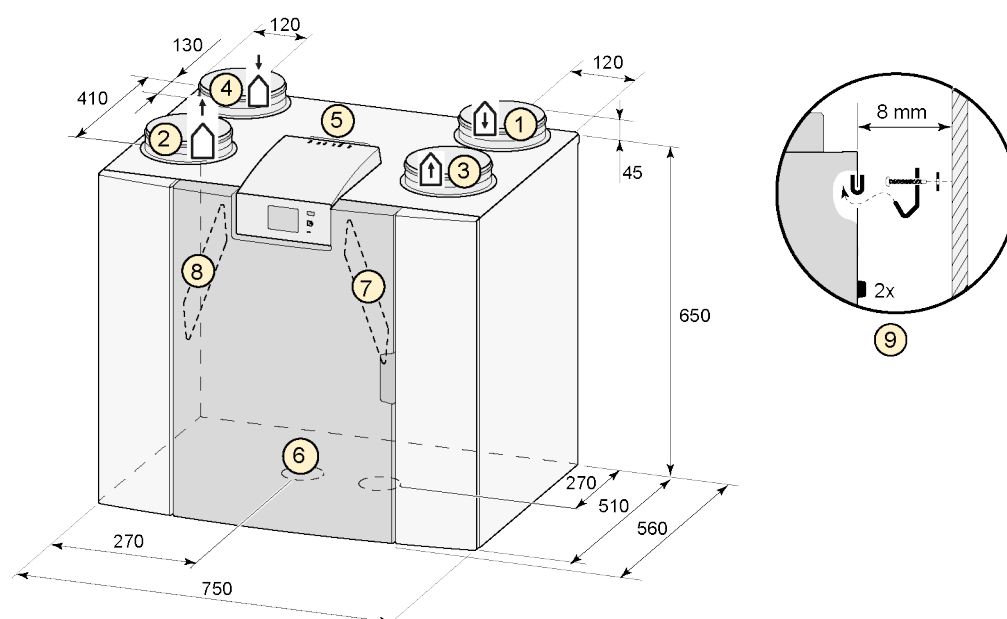

Toate dimensiunile sunt în milimetri Diametrul tuturor brățărilor este 160 mm

1	Înspre	
2	locuință înspre exterior	
3	Dinspre locuință	
4	Dinspre exterior	
5	Conexiuni electrice	
6	Siphon connection	
7	Filtru aer evacuat	
8	Filtru alimentare aer	
9	Montaj	

Service


Vedere de ansamblu detaliată

La comandarea pieselor de schimb, în plus față de codul articolului (consultați vederea de ansamblu detaliată), specificați și tipul aparatului de recuperare a căldurii, numărul de serie, anul de fabricare și denumirea piesei:

Notă: Tipul aparatului, numărul de serie și anul de producție sunt specificate pe plăcuța de timbru din spatele panoului frontal din plastic al aparatului.

Exemplu	
Tip aparat	Flair 325
Număr de serie	430000184701
An de fabricare	2019
Piesă	Ventilator
Cod articol	532759
Cantitate	1

Articole de service

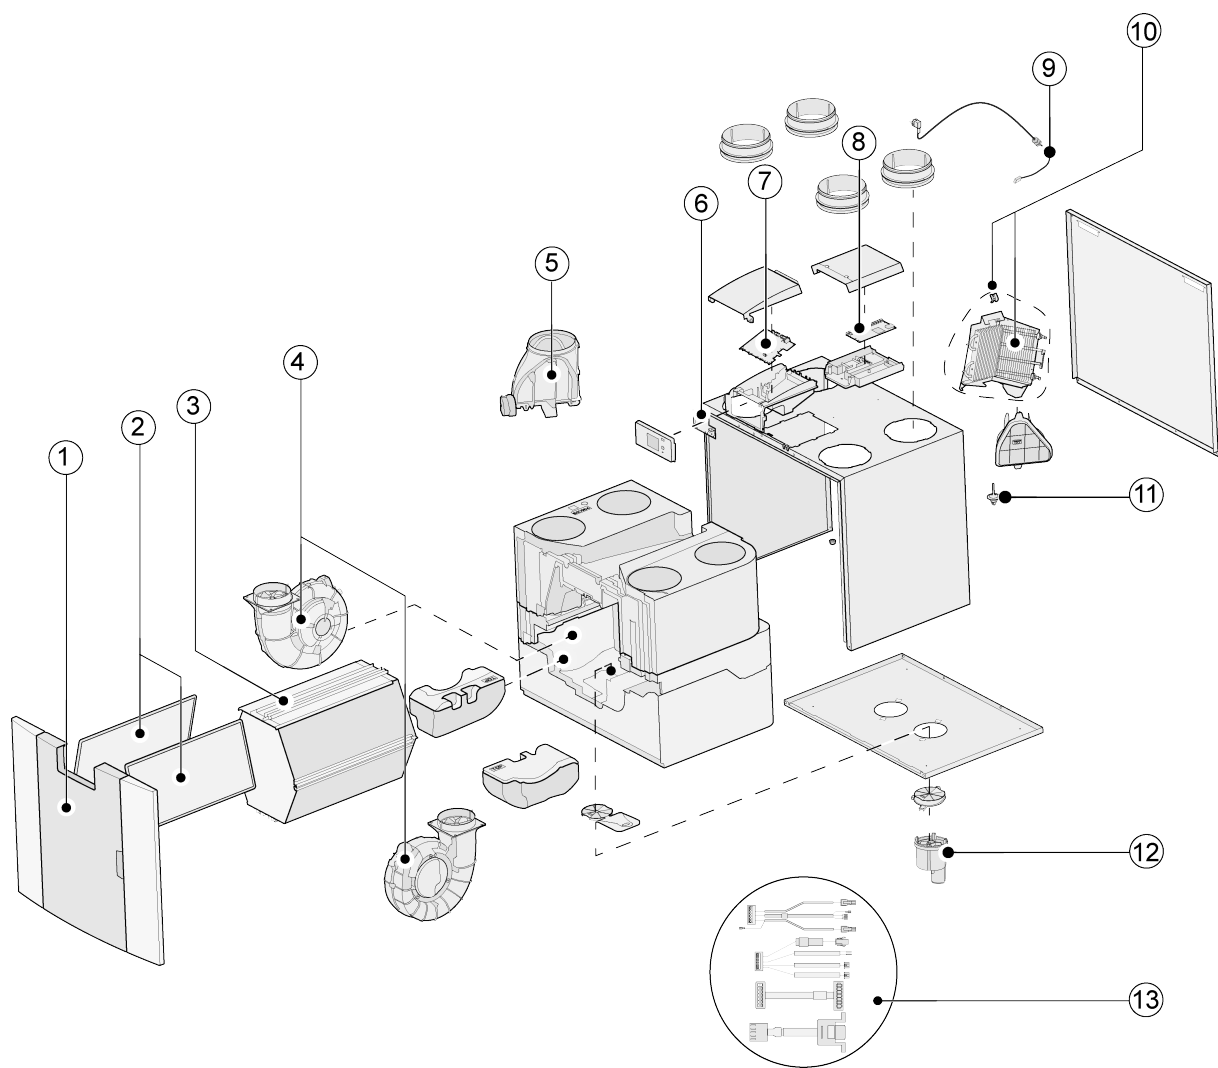

Nr.	Descrierea articolului	Cod articol
1	Panoul frontal complet	532763
2	Filtre ISO Coarse 60% (2 articole)	532716
3	Schimbător de căldură	532754
4	Ventilator (1 articol)	532759
5	Supapă de derivație cu motor complet	532760
6	Afișaj pcb UBP-2	532752
7	pcb UWA2-B de bază	532750
8	Plus pcb UWA2-E (aplicabil doar cu versiunea Plus)	532751
9	Ștecher de rețea și cablu 230 V *	532756
10	Preîncălzitor intern incl. securitate maximă	532761
11	Senzor de temperatură NTC 10K	531775
12	Descărcător de condens	532762
13	Set de cabluri	532767

* Cablul de alimentare este prevăzut cu un conector la placa cu circuite. Când îl înlocuiți, întotdeauna comandați un cablu de rețea de schimb de la Brink.
Pentru a preveni situațiile periculoase, conexiunea la rețeaua de alimentare avariata poate fi înlocuită doar de către un expert calificat.

Certificate

Declarația de conformitate

Declarația de conformitate

Producător: Brink Climate Systems B.V.

Adresa: Postbus 11
NL-7950 AA, Staphorst, The Netherlands

Produs: Aparat de recuperare a căldurii de tipul:
Flair 325
Flair 325 Plus

Produsul descris mai sus respectă următoarele directive:

- ◆ 2014/35/EU (directiva privind joasa tensiune)
- ◆ 2014/30/EU (directiva CEM)
- ◆ RoHS 2011/65/EU (directiva privind substanțele)
- ◆ 2009/125/EG (1253/1254 EU (directiva UE ErP)

Produsul poartă eticheta CE:



Staphorst, 24-11-2017

A handwritten signature in blue ink, appearing to read 'M. Schouten', written over a horizontal line.

M. Schouten
Managing Director

1 Valori ERP

Fișa cu informații tehnice Flair 325 (Plus) în conformitate cu Ecodesign (ErP), nr. 1254/2014 (Anexa IV)					
Producător:		Brink Climate Systems B.V.			
Model:		Flair 325 (Plus)			
Zonă ambientală	Tip de control	Valoare SEC în kWh/m²/a	Clasa SEC	Consumul anual de electricitate (AEC) în kWh	Încălzirea anuală economisită (AHS) în kWh
Media	Manual	-40,99	A	233	4614
	control ceas	-41,59	A	215	4628
	1x senzor (RV/CO ₂ /VOC)	-42,72	A+	181	4657
	2 sau mai mulți senzori (RV/CO ₂ /VOC)	-44,71	A+	124	4714
Rece	manual	-85,11	A+	770	9026
	control ceas	-85,85	A+	752	9054
	1x senzor (RV/CO ₂ /VOC)	-87,25	A+	718	9110
	2 sau mai mulți senzori (RV/CO ₂ /VOC)	-89,79	A+	661	9222
Cald	manual	-15,72	E	188	2086
	control ceas	-16,24	E	170	2093
	1x senzor (RV/CO ₂ /VOC)	-17,21	E	136	2106
	2 sau mai mulți senzori (RV/CO ₂ /VOC)	-18,88	E	79	2132
Tipul unității de ventilare:		Aparat echilibrat de ventilare cu recuperarea căldurii pentru aplicații rezidențiale			
Ventilator:		CE - ventilator cu control variabil infinit			
Tipul schimbătorului de căldură:		Schimbător de căldură contracurent cu recuperare din plastic			
Eficiență termică		91%			
Debit maximum:		325m³/h			
Putere nominală maximă:		144,5 W			
Nivel putere acustică Lw(A):		41 dB(A)			
Debit de referință:		228m³/h			
Presiune de referință:		50Pa			
Putere de intrare specifică (SEL):		0,15 W/m³/h			
Factor de control:		1,0 în combinație cu comutatorul multiplu			
		0,95 în combinație cu control ceas			
		0,85 în combinație cu 1 senzor			
		0,65 în combinație cu 2 senzori sau mai mulți			
Scurgere *	Internă	2,85%			
	Externă	2,85%			
Poziția indicației filtrului uscat:		Pe afișajul aparatului / pe comutatorul multiplu (LED) / pe accesoriul Brink Air Control Atenție! Pentru eficiență energetică optimă și o funcționare adecvată, este necesară inspecția, curățarea sau înlocuirea regulată a filtrului.			
Adresa de internet pentru Instrucțiunile de asamblare:		http://www.brinkclimatesystems.nl/nl/professionals			
Derivație:		Da, 100% derivație			

* Măsurători efectuate de TZWL potrivit standardului EN 13141-7

Clasificare de la 1 ianuarie 2016	
Clasa SEC („Zonă ambientală medie„)	Valoare SEC în kWh/m ² /a
A+ (Cel mai eficient)	SEC < -42
A	-42 ≤ SEC < -34
B	-34 ≤ SEC < -26
C	-26 ≤ SEC < -23
D	-23 ≤ SEC < -20
E (cel mai puțin eficient)	-20 ≤ SEC < -10

EN 13141-7:2010 Certificate

KF.82.01.257.AD.01
18.05.18



Declaration of conformity regarding the determination of energetic efficiency according to EN 13141-7:2010

On behalf of Brink Climate Systems B.V. the determination of energetic efficiency was conducted by Europäisches Testzentrum für Wohnungslüftungsgeräte (TZWL) e. V. in Dortmund, Germany.

Tests were carried out according to:

- EN 13141-7:2010; Ventilation for buildings - Performance testing of components/products for residential ventilation - Part 7: Performance testing of a mechanical supply and exhaust ventilation units (including heat recovery) for mechanical ventilation systems intended for single family dwellings

Technical data of the tested unit:

Manufacturer:	Brink Climate Systems B.V.
Type:	Flair 325 4/0 L EU
Serial Number:	430000180301
Year of construction:	2018
Power supply:	230 V ~ 50 Hz
CE-Label:	Yes
Maximum volume flow:	325 m³/h

Results, energetic efficiency 7°C:

Air flow [m³/h]	Temperature ratio, supply air $\eta_{h,su}$ [%]	Total electric power consumption P_E [W]	Specific electric power consumption [W/m³/h]
51	98,4	11,7	0,23
224	90,8	34,7	0,15
325	90,5	79,2	0,24

Results, energetic efficiency 2°C:

Air flow [m³/h]	Temperature ratio, supply air $\eta_{h,su}$ [%]	Total electric power consumption P_E [W]	Specific electric power consumption [W/m³/h]
50	97,7	11,5	0,23
225	94,0	37,0	0,16
327	93,2	86,8	0,27

Results of performance tests of aerodynamic characteristics, of heat recovery characteristics and of the effective power consumption are taken from tests with number M.82.01.257.AD.

Certificat de casă pasivă

CERTIFICATE
Certified Passive House Component
Component-ID 1288vs03 valid until 31st December 2019

Passive House Institute
Dr. Wolfgang Feist
64283 Darmstadt
Germany

Category: **Air handling unit with heat recovery**
Manufacturer: **Brink Climate Systems B.V.**
Product name: **Brink Flair 325**

Specification: **Airflow rate < 600 m³/h**
Heat exchanger: **Re recuperative**

This certificate was awarded based on the product meeting the following main criteria
Heat recovery rate $\eta_{HEI} \geq 75\%$
Specific electric power $P_{el,spec} \leq 0.45 \text{ Wh/m}^3$
Leakage $< 3\%$
Comfort **Supply air temperature > 16.5 °C at outdoor air temperature -10 °C**

Airflow range
69-251 m³/h
Heat recovery rate
 $\eta_{HEI} = 91\%$
Specific electric power
 $P_{el,spec} = 0.21 \text{ Wh/m}^3$

At an airflow of 202 m³/h, the specific electric power $P_{el,spec}$ is 0.19 Wh/m³.

www.passivehouse.com

CERTIFIED COMPONENT
Passive House Institute

Leakage
The leakage airflow must not exceed 3% of the average airflow of the unit's operating range.

Internal leakage	External leakage
2.49%	0.88%

Settings and airflow balance
It must be possible to adjust the balance of airflows at the unit itself (either between the exhaust and the outdoor airflows or between the supply and the extract airflows, if the unit is respectively placed inside or outside of the insulated thermal envelope of the building).

- This unit is certified for airflow rates of 69-251 m³/h.
- Balancing the airflow rates of the unit is possible.
- The user should have at least all the following setting options:
 - ✓ Switching the system on and off.
 - ✓ Synchronized adjustment of the supply and extract airflows to basic ventilation (70-80%), standard ventilation (100%) and increased ventilation (130%) with a clear indication of the current setting.
- The device has a standby power consumption of 3.90 W. The target value of 1 W was exceeded. The device should be equipped with an additional external switch so that it can be disconnected from the mains, if required.
- After a power failure, the device will automatically resume operation.

Acoustical testing
The required limit for the sound power level of the device is 35 dB(A) in order to limit the sound pressure level in the installation room. The sound level target value of less than 25 dB(A) in living spaces and less than 30 dB(A) in functional spaces must be ensured by installing commercial silencers. The following sound power levels are met at an airflow rate of 248 m³/h:

Device	Duct			
	Outdoor	Supply air	Extract air	Exhaust air
44.5 dB(A)	48.5 dB(A)	60.5 dB(A)	49.0 dB(A)	59.0 dB(A)

- The unit does not fulfil the requirements for the sound power level. The unit must therefore be installed acoustically separated from living areas.
- One example of suitable silencers for supply and extract air ducts is mentioned in the detailed test report or can be obtained from the manufacturer. It is recommended to identify suitable silencers for each individual project.

Indoor air quality
This unit is equipped with following filter qualities by default:

Outdoor air filter	Extract air filter
ISO ePM1 50%	ISO Coarse 60%

On the outdoor air/ supply air side the filter quality class F7 is recommended. If not standard configuration, the F7 filter is available as accessory part.

Component-ID: 1288vs033/4

www.passivehouse.com

Brink Climate Systems B.V.
Wethouder Wassenaarstraat 8, 7951 SN Staphorst, Netherlands
☎ +31 (0)522 46 96 13 | ✉ info@brinkclimatesystems.nl | 🌐 http://www.brinkclimatesystems.nl |

Passive House comfort criterion
At an outdoor air temperature of -10 °C a supply air temperature higher than 16.5 °C is achieved by use of an internal and additional external electric preheater. The criterion is therefore met.

Efficiency criterion (heat recovery rate)
The effective heat recovery rate is measured at a test facility using balanced mass flows of the outdoor and exhaust air. The boundary conditions for the measurement are documented in the testing procedure.
$$\eta_{HEI} = \frac{(\theta_{ETA} - \theta_{EHA}) + \frac{P_d}{\dot{m} \cdot c_p}}{(\theta_{ETA} - \theta_{ODA})}$$
With
 η_{HEI} Heat recovery rate in %
 θ_{ETA} Extract air temperature in °C
 θ_{EHA} Exhaust air temperature in °C
 θ_{ODA} Outdoor air temperature in °C
 P_d Electric power in W
 $\dot{m}$ Mass flow in kg/h
 c_p Specific heat capacity in Wh/(kgK)

Heat recovery rate
 $\eta_{HEI} = 91\%$

Efficiency criterion (electric power)
The overall electrical power consumption of the device is measured at the test facility at an external pressure of 100 Pa (50 Pa, respectively, for the intake and outlet). This includes the general electrical power consumption for operation and control but not for frost protection.

Specific electric power
 $P_{el,spec} = 0.21 \text{ Wh/m}^3$

Efficiency ratio
The efficiency ratio provides information about the overall energy performance of the respective ventilation unit. It specifies the achieved reduction in ventilation heat losses by using a ventilation unit with heat recovery rather than without.
$$\epsilon_L = 0.76$$

2/4

Brink Flair 325

www.passivehouse.com

Frost protection
Appropriate measures should be taken to prevent the heat exchanger and optional downstream hydraulic heater coil from getting damaged by frost during extreme winter temperatures (-15 °C). It must be ensured that the unit's ventilation performance is not affected during frost protection cycles.

- Frost protection of the heat exchanger:
 - ✓ In order to protect the heat exchanger from freezing, the unit is equipped with an internal electric preheater with a power of 1000 W. In order to ensure the frost protection even at low outdoor air temperature, the unit can be optionally equipped with an additional external electric preheater with a power of 1000 W. The operation of this frost protection is controlled depending on the outdoor air temperature. The laboratory measurement has proved, that this frost protection at an upper airflow rate and an outdoor air temperature of -15 °C is sufficient. By the laboratory testing, the preheaters were first activated by an outdoor air temperature of -5.6 °C.
- Frost protection of downstream hydraulic heater coils:
 - ✓ In order to protect a downstream hydraulic heater coil, both fans are switched off in case the supply air temperature drops down to 5 °C.

4/4

Brink Flair 325

www.passivehouse.com

Vezi si: Complet Certificat de casă pasivă